


GENERAL NOTES:

Refer to the contract documents for dimensions, grades, and additional requirements for permeable interlocking concrete pavers and associated improvements.

- ① Permeable interlocking concrete pavers as specified in the contract documents.
- ② 1 1/2" to 2" permeable pavement bedding aggregate to accommodate imperfections in the permeable pavement filter aggregate layer.
- ③ Permeable pavement storage aggregate thickness as specified in the contract documents.
- ④ When underdrain collectors and/or laterals are specified, install to the line and grade specified in the contract documents. Place permeable pavement filter aggregate to springline of pipe.
- ⑤ Subgrade and/or subbase under curb and gutter as specified in the contract documents.
- ⑥ Install paver edge restraint system along unrestrained edges.

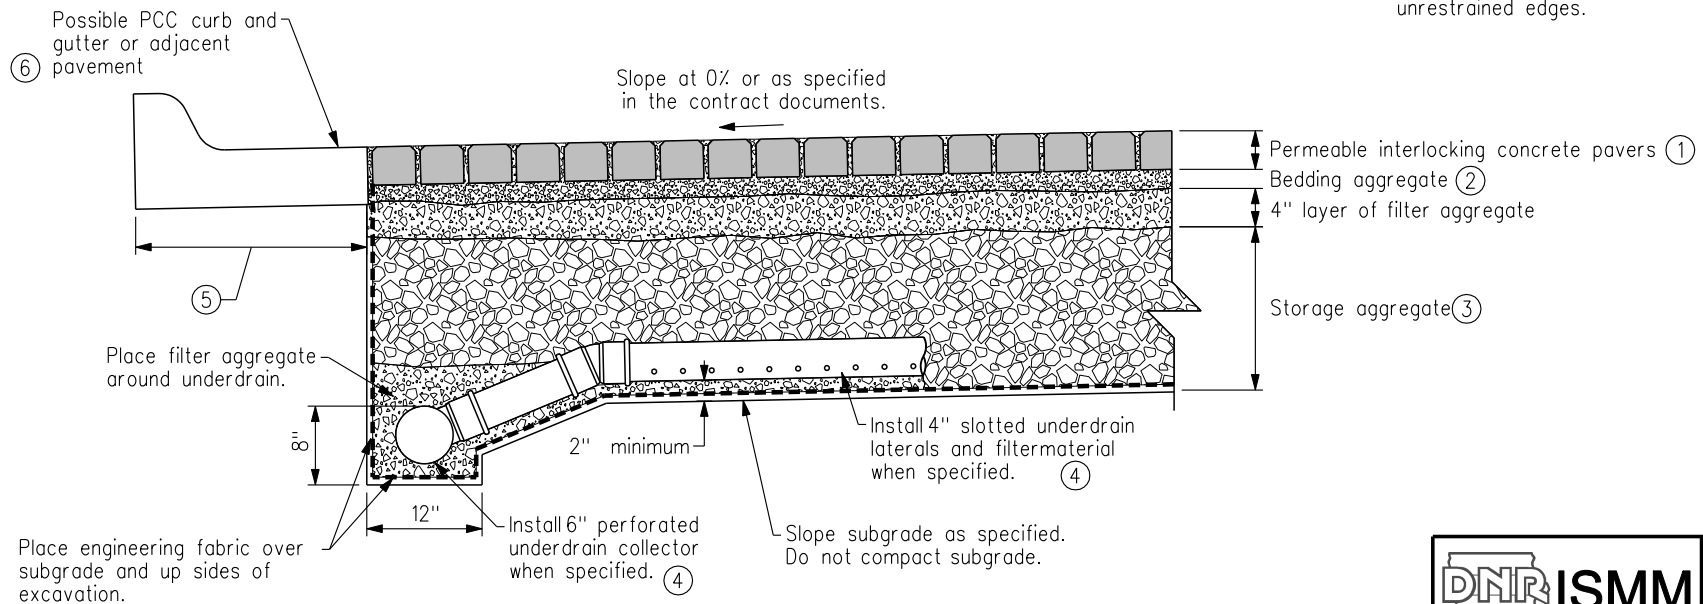

 Iowa Stormwater Management Manual	REVISION
	NEW 04/01/2010
	FIGURE 1J-4.1
	SHEET 1 OF 1

**PERMEABLE INTERLOCKING
CONCRETE PAVERS**